


TEST STATION INSTALLATION

NOTES

1. ALL DIMENSIONS ARE SHOWN IN MILLIMETRES UNLESS OTHERWISE INDICATED.
2. THIS STANDARD DRAWING IS TO BE READ IN CONJUNCTION WITH GSSS 442.
3. THE WATERMAIN LEAD WIRES ARE TO BE #10-7 STR TWB BLACK WIRES.
4. IN AREAS WHERE THE TEST STATION CANNOT BE LOCATED ADJACENT TO A UTILITY POLE OR HYDRANT, AN ALTERNATIVE POSITION CAN BE SELECTED ON APPROVAL OF THE ENGINEER.
5. THE APPROVED TEST STATION IS:
COTT MANUFACTURING Co. "LITTLE FINK".

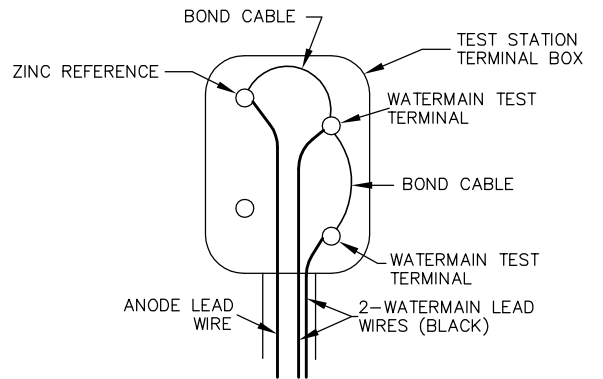

TEST STATION WIRING DIAGRAM



**TEST STATIONS
FOR CATHODIC PROTECTION
ON IRON WATERMANS**

DRAWN BY: ROH/SAG	REV No: 3
DATE: 2003-03-03	REV DATE: 2016-03-02
SCALE: NTS	CAD/FILE No.: A1975-1 (1 OF 1)
APP'D:	GSSD-1125.010

DISCLAIMER OF WARRANTY : The data is provided "as-is", without warranty of any kind either expressed or implied. Any and all liabilities for damage, direct or indirect, however caused, and resulting in any way by use of the supplied data is the full and final responsibility of the user.

COPYRIGHT : All rights are reserved. No part of the supplied data may be reproduced, or transmitted to others, in any form or by any means, without the prior written permission of the CITY OF GREATER SUDBURY.