


R2 ZONING → ← R1 ZONING

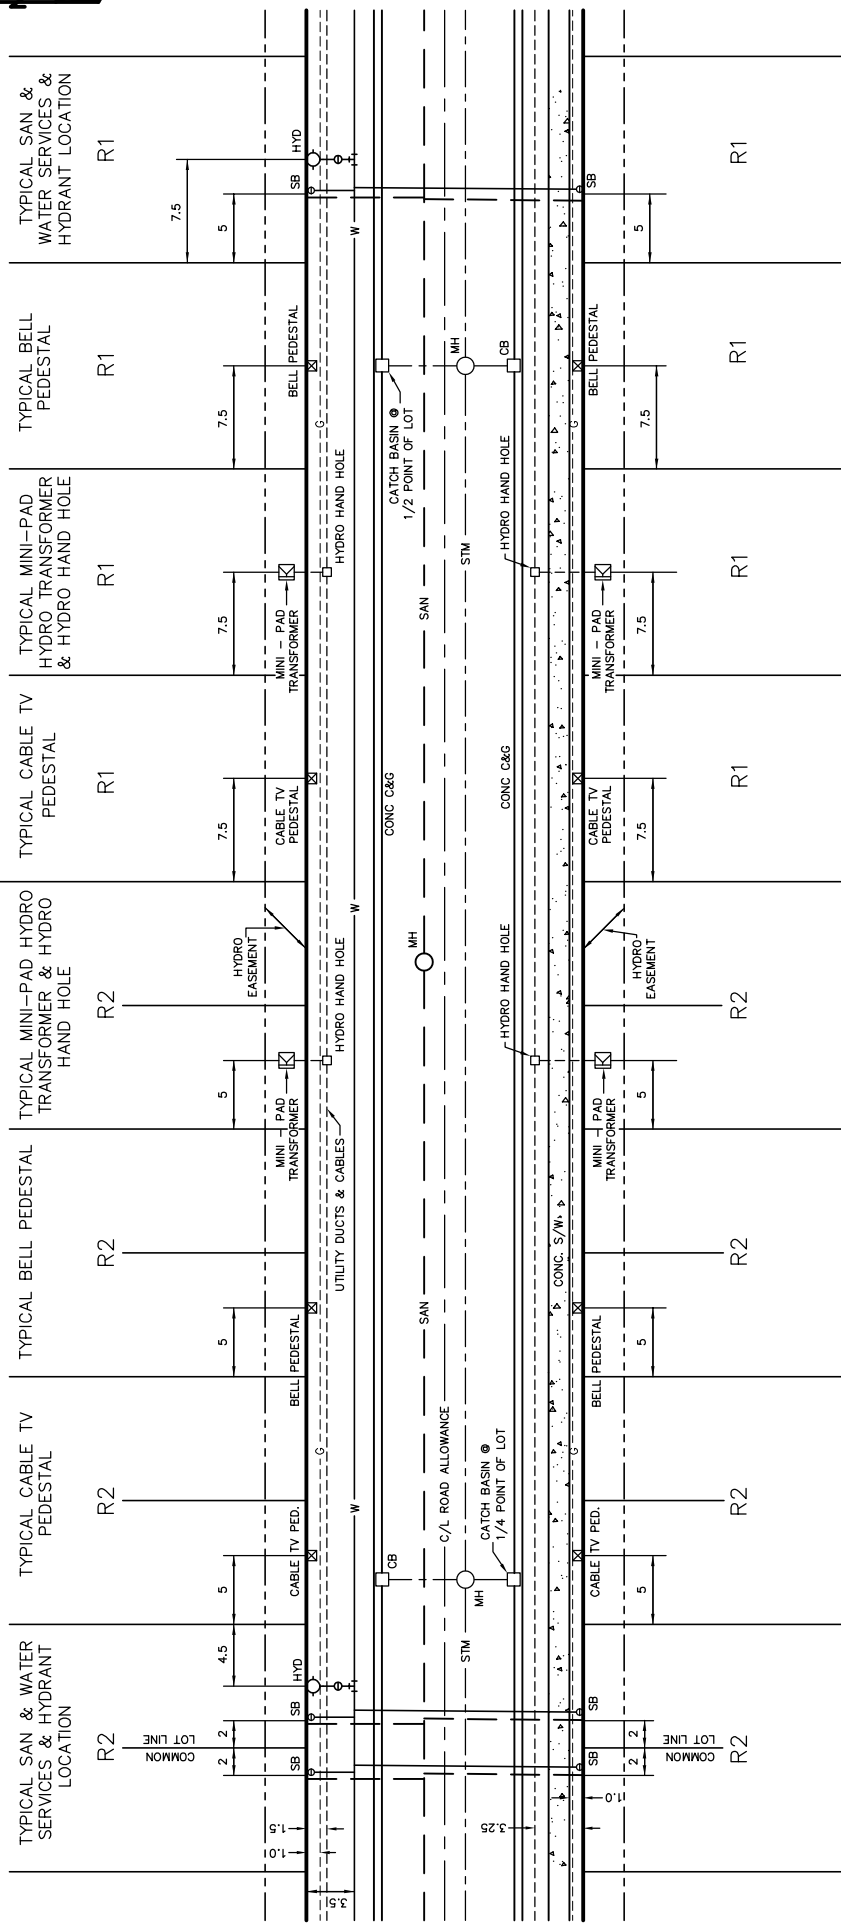

NOTES:

1. ALL DIMENSIONS ARE IN METRES UNLESS OTHERWISE INDICATED.
2. WHERE A MINI-PAD TRANSFORMER IS INSTALLED IN AN R2 LOT, THE SEWER & WATER SERVICE IS 1.5 m FROM LOT LINE RATHER THAN THE NORMAL LOCATION OF 2 m.
3. REFER TO GSSD-1226.010 FOR INSTALLATION OF SERVICES IN A ROCK TRENCH.
4. WHEN SIDEWALK IS ON THE NORTH OR EAST SIDE, THE LOCATION OF THE UTILITY DUCTS AND CABLES ARE REVERSED.
5. IF IT IS PROPOSED TO HAVE A DRIVEWAY DOWN A COMMON LOT LINE, MINI-PAD TRANSFORMER TO BE INSTALLED 5 m FROM COMMON LOT LINE.
6. SEE GSSD-225.010 FOR TYPICAL SECTION.
7. SEE GSSD-1006.030 FOR STANDARD DUAL SERVICE CONNECTIONS IN A COMMON TRENCH (SEWER & WATER).

DISCLAIMER OF WARRANTY
 The data is provided "as-is", without warranty of any kind either expressed or implied. Any and all liabilities for damage, direct or indirect, however caused, and resulting in any way by use of the supplied data is the full and final responsibility of the user.

COPYRIGHT
 All rights are reserved. No part of the supplied data may be reproduced, or transmitted to others, in any form or by any means, without the written permission of the CITY OF GREATER SUDBURY.



UTILITY SERVICES
 LOCATION PLAN

DRAWN BY: RF	REV No:
DATE: 2003-03-03	REV DATE:
SCALE: NTS	CAD/FILE No.: A1923-1 (1 OF 1)
APP'D:	GSSD-225.030