


**NOTES**

1. IF THE DIAMETER OF THE LATERAL IS SMALLER THAN THE MAIN BY 100 mm OR MORE THE CONNECTION CAN BE MADE USING APPROVED SADDLES. FOR ALL OTHER LATERAL SIZES THE CONNECTION MUST BE MADE USING APPROVED FACTORY MADE TEES.
2. FOR NEW MAIN CONSTRUCTION, FACTORY TEES ONLY TO BE USED.
3. MADE UTILIZING A MAINTENANCE HOLE AT THE MAIN.
4. SADDLES MUST BE INSTALLED ON THE MAIN PIPE BEFORE THE SERVICE PIPE IS LAID.
5. APPROVED CUT-IN TOOL MUST BE USED FOR FIELD MADE TEES.
6. SERVICE CONNECTION MUST BE SECURELY PLUGGED AT PROPERTY LINE WITH A CROWLE TEST FITTING.
7. PLUG AT PROPERTY LINE SHALL BE ADEQUATELY BRACED TO WITHSTAND TESTING PRESSURES.
8. TEST MAINTENANCE HOLE AT LOT LINE AS PER GSSD-1001.030 OR A MAINTENANCE ACCESS CHAMBER AS PER GSSD-1001.040 TO BE INSTALLED ON ALL NON-RESIDENTIAL SERVICES.
9. FOR VERTICAL RISER DETAIL CONCRETE BEDDING TO HAVE MINIMUM WIDTH OF 600mm.
9. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SHOWN.

DRAWN BY: STS/RFRANK	REV No:
DATE: 2003-03-03	REV DATE:
SCALE: NTS	CAD/FILE No.: A1954-1 (1 OF 1)
APP'D:	<b>GSSD-1006.010</b>

**SEWER SERVICE CONNECTIONS**  
FOR RIGID MAIN PIPE SEWER

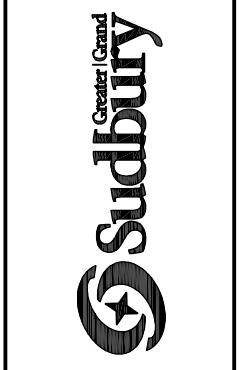

**DISCLAIMER OF WARRANTY**  
The data is provided "as-is", without warranty of any kind either expressed or implied. Any and all liabilities for damage, direct or indirect, however caused, and resulting in any way by use of the supplied data is the full and final responsibility of the user.

**COPYRIGHT**  
All rights are reserved. No part of the supplied data may be reproduced, or transmitted to others, in any form or by any means, without the written permission of the CITY OF GREATER SUDBURY.